



---

**Price® Pump Co.**

# **INSTALLATION, OPERATING AND MAINTENANCE MANUAL**

**AIR OPERATED DIAPHRAGM PUMPS  
NON-METALLIC, ALL ELASTOMERS**

**MODEL: 2.0 AOD-200N**



Price® Pump Company  
21775 8th. Street East  
Sonoma, CA 95476  
Tel: 707-938-8441  
Fax 707-938-0764  
Email: sales@pricepump.com

**PLEASE FILL IN FROM PUMP NAMEPLATE**

Pump Model\_\_\_\_\_

Spec. No.\_\_\_\_\_

Serial No.\_\_\_\_\_

**RETAIN MANUAL FOR REFERENCE**

# Congratulations

You are now the owner of a Price® Pump Co. Air Operated Diaphragm Pump. This pump was carefully inspected and subjected to final performance tests before releasing for shipment. In order to achieve maximum performance and reliability, please follow the simple instructions in this manual.

## RECOMMENDED PRECAUTIONS

1. For satisfactory operation and safety, maximum inlet air pressure must not exceed 125 psi (8.79kg/sq cm).
2. No modifications, additions or deletions should be made to the pump without prior approval of the factory.
3. Drain casing completely and flush with water before servicing a pump handling volatile or harmful liquids.

## READ CAREFULLY THE CAUTION BELOW

The performance of your Price® Co. Air Operated Diaphragm Pump is based on clean, room temperature, water with suction conditions as shown on the performance curves. If used to pump other liquids, pump performance may differ from rated performance based on the different specific gravity, temperature, viscosity, etc. of the liquid being pumped. A standard pump, however, may not be safe for pumping all types of liquids, such as toxic, volatile or chemical liquids, or liquids under extreme temperatures or pressures.

Please consult Price® Pump catalogs as well as local codes and general references to determine the appropriate pump for your particular application. Since it is impossible for us to anticipate every application of a Price® pump, if you plan to use the pump for a non-water application, contact Price® Pump beforehand to determine whether such application may be proper and safe under the circumstances. Failure to do so could result in property damage or personal harm.

Visit our website for product information and technical support

[www.pricepump.com](http://www.pricepump.com)

# OPERATING INSTRUCTIONS

## AIR OPERATED DIAPHRAGM PUMPS

### 200N, ALL ELASTOMERS

#### INSTALLATION

Bolt pump to a mounting pad using appropriately sized diameter bolts. Rubber vibration insulators should be used between the pump mounting feet and mounting pad to reduce pump vibrations and stresses. In permanent installations the pump should not be directly attached to rigid piping, but instead should be connected through flexible hoses or equivalent on both the suction and discharge. This should be done to reduce pipe stresses and vibrations which are characteristic of the reciprocating nature of the pump. A surge suppressor may be required on the discharge line of the pump if further reduction in vibration or a reduction of pulsation in the discharge flow is desired.

If the pump is used in a submerged application a line or hose should be attached to the pump air exhaust to prevent liquid from entering the air valve when the pump is shutdown or operating at low discharge heads.

**CARE MUST BE EXERCISED WHEN SUBMERGING THE PUMP IN CORROSIVE PUMPING MEDIA.**

Suction and discharge pipe size should be at least equal to the inlet pipe diameter or larger. Larger, if highly viscous liquid is to be pumped or long lengths of pipe are used. When using suction hoses use the non-collapsing reinforced type, since this pump is capable of producing high vacuum at the suction inlet.

#### SOLIDS-HANDLING CAPABILITY

Price® Pump Air Operated Diaphragm Pumps will pass the following spherical solid sizes:

Model	Particulate Size
0.5 AOD	1/8" Dia. (3.2mm)
1.0 AOD	1/8" Dia. (3.2mm)
1.5 AOD	3/16" Dia. (4.7mm)
2.0 AOD	3/8" Dia. (9.5mm)
3.0 AOD	7/16" Dia. (11mm)

If the possibility exists that larger sized solids may be suspended or carried along by the pumping media, install a strainer on the suction line with smaller sized

holes than the allowable solid size. This will prevent the larger solids from entering the pump and interfering with operation of the pump ball valves.

#### AIR SUPPLY

The inlet to the air valve is a female NPT fitting. The air supply line should be sized accordingly so that there is no restriction less than inlet pipe size.

**NOTE:** Long air lines require larger diameters to minimize air system pressure loss to insure the required air pressure and flow rate at the pump air inlet. It is safe to use up to **125 psig (8.79 kg/sq cm)** for pumping requirements.

**WARNING: DO NOT EXCEED 125 PSIG (8.79 KG/SQ CM) AIR SUPPLY PRESSURE AS COMPONENT DAMAGE OR PERSONAL INJURY MAY RESULT.**

#### PUMP CONTROL

The pump operating conditions, flow (GPM) and discharge head (PSIG) can be controlled in the following manner

1. Throttling the pump discharge by means of a valve on the discharge line. When the pump discharge pressure equals the air supply pressure, the pump will stop. This will not harm the pump; however, do not exceed **125 psig (8.79 kg/sq cm)** air supply pressure. The pump may be in this mode indefinitely. By opening the discharge valve the pump will resume pumping.

2. The air pressure supply can be limited to the pump. Price® Pump recommends the installation of a Price® Pump air filter/pressure regulator for all AOD applications. A globe or gate valve can be used before the regulator for on or off control. Failure to use an air pressure regulator will cause the pump air inlet pressure and thus discharge pressure to climb to maximum air system pressure when the pump is stopped.

#### MINIMUM AIR SUPPLY PRESSURE

This air valve incorporates a stall-free design and will begin operating with air inlet pressures as low as **5 psig (.35 kg/sq cm)**.

# OPERATING INSTRUCTIONS

## OPERATING INSTRUCTIONS

The pump air valve is of an oilless design; that is, no lubrication is required or recommended. A clean, dry air supply should be provided for optimum air valve operation and life. In cold weather operation, or under conditions of high pump discharge pressure and relatively high humidity, air valve freezing may occur as a result of moisture in the compressed air being released. If this occurs, anti-freeze, of the ethylene glycol type, may be used in a measuring dispenser, such as an air line lubricator at the pump air inlet. The resulting mist will keep the air valve free of ice build-up.

1. In cases where there are several air-operated diaphragm pumps being used simultaneously and freezing of the air valve occurs frequently due to excessive moisture in the compressed air system, it may be advantageous to install a desiccant type compressed air dryer in the air system to purge the air supply of unwanted moisture.

For permanent installations, an air filter and water/oil separator should be used. This is always good practice, since it insures maximum life of the air valve moving parts and seals by keeping them clean of dirt and oil residue.

Excessive oil and water in the inlet air supply will cause a varnish-like substance to form on the self-lubricated valve spool. This will eventually lead to valve spool "sticking" and result in erratic spool operation. Should this occur, the spool and housing bore may be cleaned with a commercial safety solvent.

2. When starting the pump, make sure all valving on the suction and discharge lines are open. The pump will not prime with the valving closed. Pump cavitation will occur if the suction line is restricted with foreign matter. Use a suction strainer with hole size less than allowable solid size for model in question.

3. When pumping highly viscous materials, it is advisable to check the pump flow rate vs. the pump stroke rate.

PUMP MODEL	AVG. GALS. PER STROKE*	
	Std. Elastomers	Teflon Elastomers
.5 AOD-Non Metallic	.016 (.06L)	.014 (.05L)
1.0 AOD	.18 (.68L)	.15 (.58L)
1.5 AOD	.35 (1.3L)	.20 (.75L)
2.0 AOD	.85 (3.2L)	.80 (3.0L)
3.0 AOD	8.7 (3.3L)	.82 (3.1L)

\*Actual test data with flooded suction and specific gravity of 1.0.

One pump stroke is equal to one exhaust discharge. The pump should not pump faster than the material is capable of being drawn into the pump inlet. If this occurs, cavitation will occur and could damage to the pump.

4. To determine maximum pumping speed, increase air supply pressure while observing pump discharge increase. When discharge flow no longer increases, throttle back air until pump discharge flow starts to fall off. This point is the optimum pumping speed achievable under those controlled by either one of the two methods previously mentioned under the PUMP CONTROL section of this manual.

5. The pump air exhaust port should be kept free from blockage. The pump should never be operated submerged without installing a line to the exhaust port and directing the same above the liquid surface. An appropriately sized hose with a male NPT connector may be piped up to the exhaust port and directed away. The exhaust line, if required, should be kept as short as possible or pump performance could be affected. If long lengths of exhaust line are necessary, increase the internal diameter of the exhaust line to minimize pressure drop and pump performance loss. If the exhaust sound level becomes too objectionable, use the air muffler provided.

**NOTE:** Installing an air exhaust muffler on a submerged pump will not prevent the liquid in which the pump is submerged, from entering the air valve.

**CAUTION:** If a diaphragm failure occurs, the pumping media may be blown out the exhaust port. This could be hazardous if the pumping media is toxic or aggressive. It is advisable to add a line to the exhaust port and direct it safely away when pumping toxic or aggressive media.

6. Drain pump and flush after use when pumping material which can pack, settle out of liquid suspension, or solidify in time. A packed pump can cause damage to the diaphragm clamping plates and pump shaft when started after a period of interrupted use. The pump may be inverted and drained through the discharge port and flushed through the suction port.

## OPERATING TEMPERATURE

The pump should not be used to pump liquids above **248°F (120°C)**. **Verify elastomer & case material temperature limits before installation.** For operating temperatures above **248°F (120°C)** consult factory.

# TROUBLESHOOTING

---

## TROUBLESHOOTING

### 1. Pump will run but will not pump.

- a. Check suction line for leaks.
- b. Tighten bolts or clamps on suction manifold of pumps.
- c. Material too viscous to pump at high rate of flow - slow down pump by reducing air supply pressure to pump or use larger diameter suction line.
- d. Suction manifold & pump chambers misaligned - disassemble & realign.
- e. Suction or discharge balls jammed open with foreign object - disassemble pump and remove foreign object.

**NOTE:** Optimum priming speed for these pumps is obtained when air inlet pressure is maintained between 15-20 psi, (1.0-1.4 kg/cm<sup>2</sup>) with open pump discharge.

### 2. Air bubbles in pump discharge line

- a. Check suction line and manifold bolts or clamps for leaks.
- b. Cracked or ruptured diaphragm.

### 3. Intermittent pump operation and/or ice blowing from exhaust port.

- a. Remove obstruction from suction line.
- b. Valve freeze-up - install de-icing device on air inlet line or suitable air dryer in compressed air line.
- c. Sticky air valve - remove main spool & clean with safety solvent.

### 4. Pump stops pumping.

- a. Increase air supply pressure but **DO NOT exceed 125 psig (8.79 kg/cm<sup>2</sup>)** under any circumstances and check for obstruction in suction or discharge line.
- b. Spool sticking - remove main spool & clean with safety solvent - install suitable filter on air inlet if dirt or contaminants persist.
- c. Air valve ice-up - excess moisture on the muffler is an indication that significant water is present in the air supply. Depending on the degree of severity, an in line water separator or air dryer is recommended.

### 5. Severe pump vibration with intermittent flow.

- a. Ruptured diaphragm - disassemble pump, replace diaphragm and clean air valve if necessary.
- b. Mechanical failure - disassemble pump and inspect for bent shaft, ruptured diaphragm, other part failure.

### 6. Pumping media leaking from exhaust port.

- a. Ruptured diaphragm - disassemble pump, replace diaphragm - clean air valve if necessary.

### 7. Varying pump discharge per stroke.

- a. Remove suction manifold and check for obstructions.
- b. Worn or leaky ball valves & seats - disassemble pump and replace worn parts.
- c. Check to verify bolts are fastened tightly and re-torque if necessary.

### 8. Slowing of pumping action

- a. Clogged air exhaust muffler - clean or replace
- b. Ice buildup in air valve - install de-icing device on air inlet line.

# REPAIR AND MAINTENANCE

---

## DISASSEMBLY INSTRUCTIONS FOR

### 2 AOD, POLYPROPYLENE & PVDF

#### ALL ELASTOMERS

1. Pump should be disassembled in the normal upright position. Remove the discharge manifold by removing the cap screws and flat washers. Note that these cap screws mate to inserts in the pump chamber.

2. Remove o-rings, ball valve cages, ball valves, and ball valve seats from both pump chambers.

3. Turn the unit upside down so that the suction manifold is facing up. Remove the suction manifold by removing the cap screws and flat washers. Note that these cap screws mate to inserts in the pump chamber.

4. Remove o-rings, ball valve cages, ball valves, and ball valve seats from both pump chambers.

5. Check all o-rings, ball valves, ball valve cages and ball valve seats for excessive wear or deep gouges. Replace if necessary. Excessively worn parts will adversely affect pump performance.

6. Turn unit on its side so that it is resting on one of the pump chambers. Remove the cap screws and flat washers fastening the other pump chamber to its air valve half. Note that the four cap screws mate to inserts in the pump chamber. The other eight cap screws mate to hex nuts and flat washers. Remove pump chamber. Depress diaphragm assembly into the air valve half by gently pushing on the outer diaphragm plate.

7. Turn the unit over so that it is resting on the air valve half and the other pump chamber is facing up. Remove pump chamber per the previous instructions from step #6.

8. Place the hex head of one of the outer diaphragm plates in a table vise and remove the opposing outer diaphragm plate. If a vise is not available two wrenches can be used. Remove the diaphragm, gortex tape (Teflon only), diaphragm, backup diaphragm (Teflon only), diaphragm plate, and bumper.

9. Remove pump shaft and remaining diaphragm assembly (still attached) from pump by sliding through the sleeve bearings. Place free end of shaft in a soft metal jaws vise (or place two blocks of wood between the vise jaws to protect the shaft) and remove the outer diaphragm plate and the remaining parts.

10. Check all diaphragms and rubber bumpers for wear. Replace if necessary. Excessively worn parts will adversely affect pump performance.

11. Check shaft sleeve bearings and inner clamp plate for wear or mechanical damage. Replace any worn parts.

12. Refer to air valve disassembly instructions elsewhere in this manual.

# REPAIR AND MAINTENANCE

---

## RESASSEMBLY INSTRUCTIONS FOR

### 2 AOD, POLYPROPYLENE & PVDF

#### ALL ELASTOMERS

1. Place the pump shaft in soft metal jaws vise or place two blocks of wood between the vise jaws to protect the shaft. Assemble new rubber bumper, inner diaphragm plate, backup diaphragm (Teflon only), diaphragm, diaphragm guard, and outer diaphragm plate to pump shaft. Apply a few drops of Loctite #242 (or equivalent) to pump shaft threads. Tighten outer clamping plate but do not torque down completely until later in the reassembly.

2. Insert the shaft and diaphragm assembly through the sleeve bearings in the air valve halves. Check for free movement of the shaft. Shaft must not bind. Depress the diaphragm assembly completely into the air valve half.

3. Turn the unit over so that the threaded end of the shaft is facing upwards. Assemble new rubber bumper, inner diaphragm plate, diaphragm (with convex side facing toward the end of the shaft), and outer diaphragm plate to pump shaft. Apply a few drops of Loctite #242 (or equivalent) to pump shaft threads. Tighten outer clamping plate but do not torque completely until later in the reassembly.

4. Place the hex head of one of the outer plates in a table vise and tighten the opposing outer diaphragm plate. Torque the assembly to **80 ft. lbs. (108n-m)**.

5. Depress one of the diaphragm assemblies completely into one of the air valve halves. Set this side flat onto the workbench so that the other diaphragm is facing up.

6. Carefully align the Gortex tape (Teflon only) along the outer bead of the diaphragm. Now align the taped outer bead of the diaphragm with the groove on the air valve half. Place the pump chamber over the diaphragm so that the bead on the diaphragm is aligned with the groove on the pump chamber. The pump chamber should be oriented so that the suction port runs parallel to the muffler and the discharge port is facing up toward the main spool housing. Assemble the pump chamber to the air valve half using twelve cap screws

and flat washers. Four of these cap screws will mate to inserts located in the pump chamber. Eight of the cap screws will engage flat washers and hex nuts. Torque each cap screw to **15 ft. lbs. (20n-m)**.

7. Turn the unit over so that it is resting on the pump chamber previously fastened. Repeat step #6 for the other side of the unit.

8. Turn unit upside down so that it is resting on the discharge ports of the pump chamber and the suction ports are facing up. Place a ball cage, ball valve, ball valve seat and o-ring into each suction port of the pump chamber. Check to make sure the surface of the o-ring is above the surface of the pump chamber.

9. Fasten the suction manifold to each pump chamber using eight flat washers and cap screws. The cap screws will mate to inserts located in each pump chamber. Torque each cap screw to **25 ft. lbs. (34n-m)**.

10. Turn the unit right-side up so that it is standing on its feet. Place a ball valve seat, ball valve, ball cage and o-ring into each discharge port of the pump chamber. Check to make sure the surface of the o-ring is above the surface of the pump chamber.

11. Fasten the discharge manifold to each pump chamber using eight flat washers and cap screws. The cap screws will mate to inserts located in each pump chamber. Torque each cap screw to **25 ft. lbs. (34n-m)**. Note that the suction and discharge manifolds can be oriented to fit the installation requirements.

## REPAIR AND MAINTENANCE

---

### DISASSEMBLY INSTRUCTIONS FOR THE AIR VALVE CENTER SECTION

1. Place the air valve center section on its side so that it is resting on one of the air valve halves and the other is facing up. Remove the lower two Allen head cap screws from the spool housing. Do not remove the other two Allen head cap screws at this time.
2. Remove the two flat head cap screws from inside the upper air valve half. Remove flathead cap screw from the coupling nut.
3. Carefully turn the unit over so that the other air valve half is facing up. Remove the two flat head cap screws from the upper air valve half. Remove flathead cap screw from the coupling nut.
4. Separate the two air valve halves carefully. Note that the lower air valve half will have the spool housing still attached.
5. Remove the pilot spool carefully by withdrawing it up through the open side of the spool housing. Inspect the pilot spool for excessive wear. Replace if worn or loose in its bore.
6. Remove the spool housing by removing the last two Allen head cap screws. Remove and inspect the spool housing gasket. Replace if necessary.
7. Inspect the air valve gasket and replace if necessary. Remove the pilot spool seals from the air valve halves. Inspect the seals and replace if necessary.
8. Inspect the pump shaft seals and the sleeve bearings without removing them from the air valve halves. If it becomes necessary to replace the sleeve bearings, they can be pressed out of each bore. The shaft seals can be removed by prying them out with a screwdriver or similar blunt end tool.
9. Remove the mufflers from each air valve half. Inspect the muffler for damage or any debris that may be trapped inside. Restrictions to air flow will adversely affect pump performance. Clean the mufflers thoroughly or replace with new.

10. Inspect the air valve halves. Clean any exposed passages to ensure complete and unobstructed air flow. Should the interior surfaces be coated with oil, clean thoroughly all internal passages and both main and pilot spools prior to reassembly. Make sure an air filter or air filter regulator is installed on the air inlet line upon reinstallation.

11. Remove the spool caps from the spool housing by removing the eight cap screws. Remove and inspect the cap gaskets. Replace if necessary.

12. Remove the main spool from the spool housing by pushing the spool through one end of the housing. The spool should slide out of its bore freely. Do not hit the spool or tap it out of the bore. If the spool does not slide freely by hand pressure alone, then press the spool out of the bore. Inspect the main spool and the piston rings for wear. Replace if worn or damaged. Worn parts will adversely affect pump performance.

### RESASSEMBLY INSTRUCTIONS FOR THE AIR VALVE CENTER SECTION

**Caution:** Care must be exercised during reassembly to ensure cleanliness. A dirty air valve will stick and function improperly. Keep area free of dirt, oil and metal chips and insure parts are free of defects.

#### 1. MAIN SPOOL ASSEMBLY

a. Inspect main spool for chips and scratches and replace if necessary. Clean main spool, pilot spool and the spool bores in the spool housing with a good grade safety solvent prior to reassembly. The solvent should be of a type that evaporates and does not leave a film or oil on the components. Remove any obstructions from the signal ports in the spool housing using a pipe cleaner.

b. Assemble the piston ring set to the main spool. Place each metal expander into one of the grooves on the main spool. Place a Teflon piston ring over each metal expander. Note that the split in the piston ring should be placed 180° from the split in the metal expander. These parts should move freely on the main spool.



## REPAIR AND MAINTENANCE

---

2. Insert the main spool and piston ring assembly into the spool housing. Note that the split in each Teflon piston ring should enter into the spool bore at either the 3 or 9 o'clock position relative to the main air inlet of the spool housing.

**NOTE:** This will prevent the splits from hanging up on one of the air ports machined into the spool bore. Carefully compress each piston ring set as it enters the spool bore. Be certain to push the main spool completely into the bore so that one end of the main spool is flush with one end of the spool housing bore. Do NOT assemble the main spool in a centered position or the pump will not start.

3. Install spool cap gaskets and end caps to both ends of the spool housing and fasten with cap screws. Align the slots in the gaskets and caps with the 3/16" hole at the 9 o'clock position on the flange.

**NOTE:** Tighten cap screws only until the gaskets start to protrude.

4. Install 3/4" NPT pipe plug into the spool housing.

### AIR VALVE ASSEMBLY

1. Place the two air valve halves on a clean firm surface so that the ribs are facing up.

2. Install the main Polypak seals into each bore of both air valve halves. Note that the cupped side of the seal should face down toward the diaphragm area.

**NOTE:** Be sure the seal is seated evenly in the counter bore at the bottom.

3. Apply a small amount of Loctite 609 (or equivalent) to the sleeve bushing bore. Carefully press one of the Oilite sleeve bushings into the sleeve bushing bore of each air valve half. Make sure the bushing presses in squarely and makes contact with the shoulder located in the bottom of the bore.

**NOTE:** Do not attempt to force the bushings any deeper into the bore once contact with the shoulder is achieved.

4. Install a pilot spool Polypak seal into each air valve half, making sure that the cupped side of the seal should face down toward the diaphragm area.

5. Apply 3M SUPER77 adhesive (or equivalent) to the beveled edge of one flat head screw, apply a drop of Loctite #242 (or equivalent) to the threads and insert through the hole of the air valve closest to the muffler port, threading it into the coupling nut a maximum of three threads.

6. Apply 3M SUPER77 adhesive (or equivalent) to both sides of the air valve gasket.

7. Carefully align and place the air valve gasket onto one of the air valve halves.

8. Apply 3M SUPER77 adhesive (or equivalent) to both sides of the spool housing gasket.

9. Carefully align and place spool housing gasket onto spool housing.

10. Insert the pilot spool through the open end of the spool housing.

11. Gently position the spool housing onto the air valve housing half. Carefully slide the pilot spool through the Polypak seal which will protrude approximately 1/2" into the diaphragm side of the air valve housing half.

**IMPORTANT:** Slightly tilt the spool housing away from its mounting platform and make sure the spool housing gasket did not move during positioning.

12. Place the other air valve housing half onto the air valve assembly. Allow the pilot spool to pass through the Polypak seal and into the air side of the air valve housing half.

**IMPORTANT:** Be certain the air valve gasket and the spool housing gasket sit flat and are aligned with each respective bolt hole.

13. Apply 3M SUPER77 adhesive (or equivalent) onto the beveled edge of two flat head cap screws and flat head screw and one drop of Loctite #242 (or equivalent) onto the threads. Install the cap screws and screw in to the upper air valve half. Note that the two cap screws will mate to inserts located in the lower air valve half.

## REPAIR AND MAINTENANCE

---

14. Loosely fasten the air valve housing halves together.

15. Apply silicon spray on the pump shaft and gently insert it into the air valve assembly.

16. Carefully turn the unit so that the spool housing is facing up. Apply Loctite #242 (or equivalent) to cap screws and fasten the spool housing onto the air valve assembly.

**NOTE:** Semi-tighten the cap screws at this time for alignment only.

17. Carefully turn the unit again so that the other air valve housing is facing up. Apply 3M SUPER77 adhesive (or equivalent) onto the beveled edge of the remaining cap screws and flat head screw, place one drop of Loctite #42 (or equivalent) onto the threads and install them into the air valve assembly.

18. Using a torque wrench, torque the air valve assembly fasteners and in a crossing pattern to **13 ft. lbs. (18n-m)**.

19. Torque the spool housing cap screws in a crossing pattern to **13 ft. lbs. (18n-m)**.

20. Proper alignment of the air valve housing halves and the spool housing should allow for free movement of the pilot spool and pump shaft. It is normal for the pilot spool and pump shaft to encounter some resistance in movement.

21. Install muffler into each exhaust port located 180° from the spool housing. The mufflers only need to be hand tightened. Do not use a wrench to tighten the mufflers.

THIS PAGE INTENTIONALLY LEFT BLANK



## 2" AOD Polypropylene & PVDF Parts List

(All Elastomers Except Teflon)

**PRICE PUMP CO.**

AOD2Pplst.doc rev. D

Key #	Description	Quantity	Part #	Material
1	Chamber, Pump	2	47-988-□□	Customer Preference
4	Plate, Diaphragm (Outer)	2	47-985-80	PVDF
6	Diaphragm	2	44-101-**	Customer Preference
7	Plate, Diaphragm (Inner)	2	49-021-00	Stainless Steel
8	Bumper	2	44-106-00	Polyurethane
9	Cap Screw	16	3085	Stainless Steel
10	Spacer			
	(Only on Santoprene Elastomer Pumps)	2	49-112-00	Stainless Steel
11	Cap Screw	8	60-024-00	Stainless Steel
12 +	Seal	2	46-060-00	Molythane
14 +	Seal	2	44-372-00	Molythane
15 +	Gasket, Air Valve / Chamber	1	48-636-00	Santoprene
16	Shaft, Pump	1	49-109-00	Steel - Nitrided
23	Manifold, Discharge	1	47-986-□□	Customer Preference
24	Manifold, Suction	1	47-987-□□	Customer Preference
28	Seat, ball Valve	4	47-983-50	Teflon
29	Ball Valve	4	44-102-**	Customer Preference
32	Hex, Nut	16	60-061-00	Steel - Zinc Plated
35	Cap Screw, Socket Head	8	51-640-00	Stainless Steel
36	Cap, Spool, Air Valve	2	46-217-40	Aluminum
37 +	Gasket, Cap	2	46-218-00	Polyurethane
38	Pipe Plug	1	60-056-00	Stainless Steel
39 +	Spool, Air Valve	1	47-180-00	Phenolic
42	Elbow	2	44-129-00	Polypropylene
43 +	Sleeve, Bushing	2	44-120-00	Bronze
44 +	Muffler	2	44-127-66	Polypropylene
45 +	Piston Ring w / Expander	2	44-366-00	Phenolic / Stainless Steel
47	O-ring			
	-Pumps using Santoprene Elastomers	4	46-182-00	Teflon Encapsulated Viton
	-Pumps using other Elastomers	4	49-* * *-00	Customer Preference
52	Cap Screw	16	60-024-00	Stainless Steel
57	Cage, Ball Valve	4	47-991-□□	Customer Preference
68	Housing, Spool	1	47-996-10	Stainless Steel
82 +	Pilot Spool, Air Valve	1	47-587-00	Phenolic / Stainless
86	Chamber, Air	2	47-995-00	Polypropylene
91	Cap Screw	4	48-946-00	Alloy - Zinc Plated
95	Cap Screw, Socket Head	4	48-950-00	Stainless Steel
96	Flat Washer	56	49-015-00	Stainless Steel
98 +	Gasket, Spool Housing	1	48-967-00	Santoprene
99	Capscrew, Flat Socket Head	2	49-018-00	Alloy - Zinc Plated
100	Coupling Nut	1	49-017-00	Steel - Zinc Plated
	Air Valve Rebuild Kit			
	-Includes All Parts with +	1	48-620-00	
	Elastomer Kit	1	49-051-**	


□□ Pump Material: 00 - Polypropylene  
80 - PVDF

\*\* Elastomers: 00 - Neoprene  
10 - Buna-N  
20 - Viton  
30 - Nordel  
60 - Santoprene

\* \* \* Elastomers: 022 - Buna-N  
023 - Viton  
024 - Nordel  
025 - Neoprene



PRICE PUMP CO.

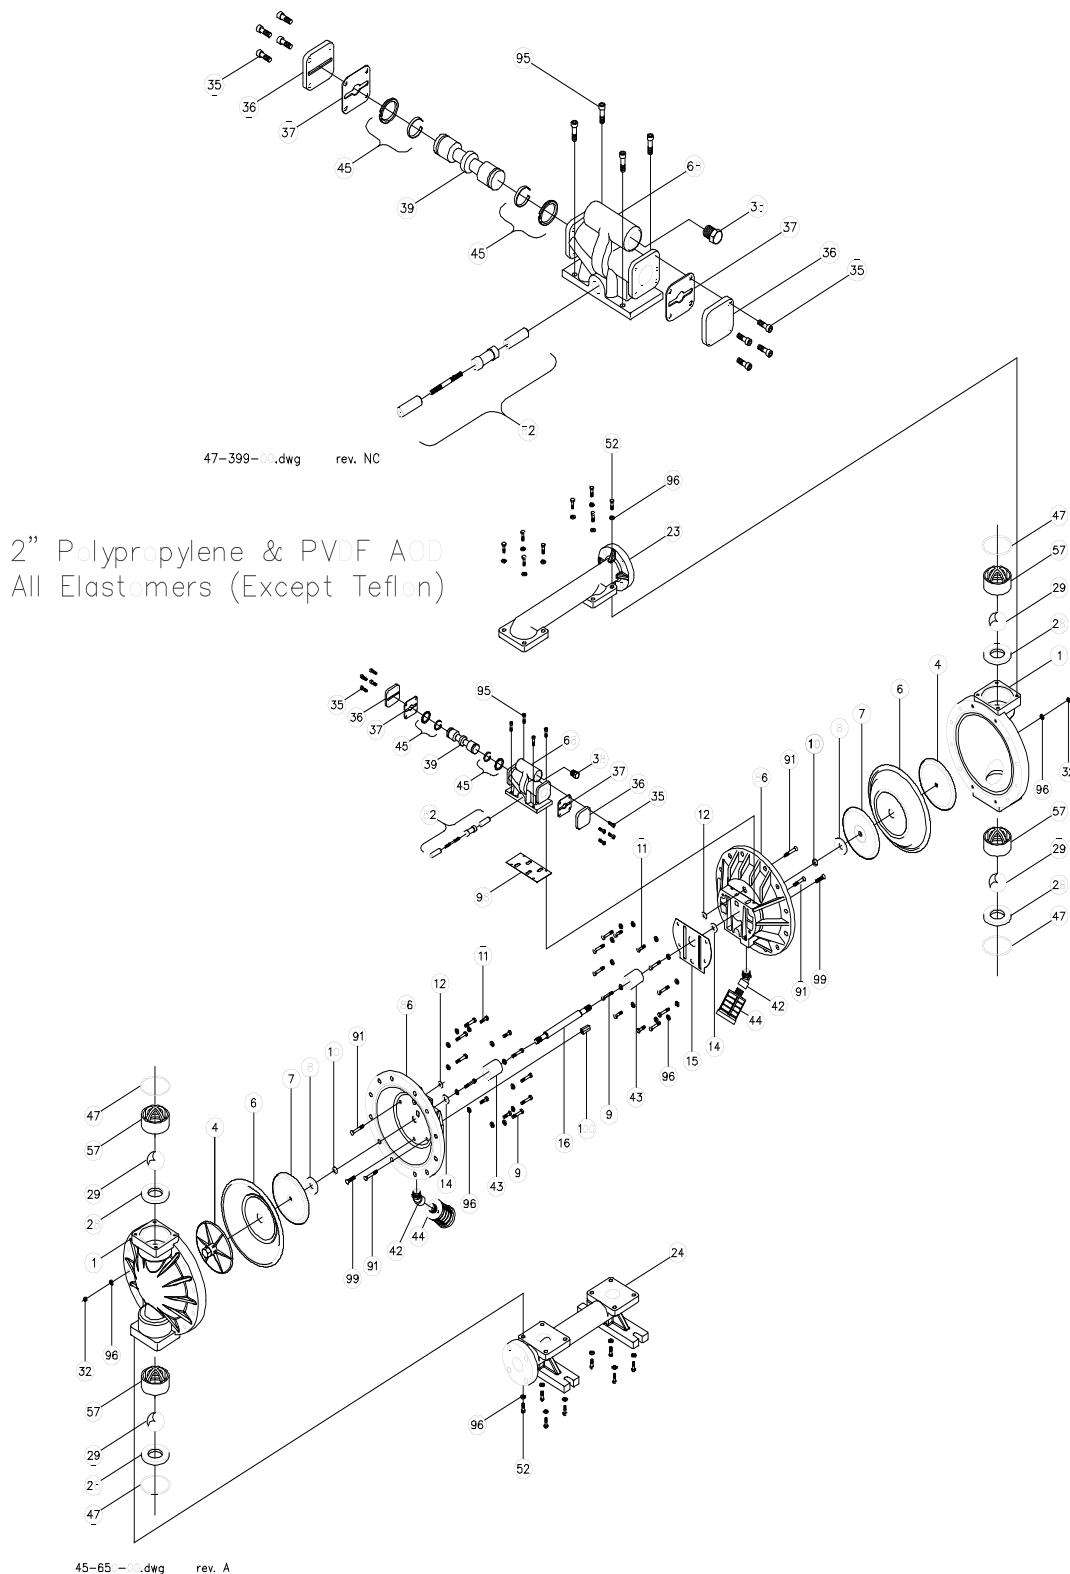

2" Polypropylene & PVDF AOD  
All Elastomers (Except Teflon)

Price<sup>®</sup> Pump Co.

21775 Eighth Street East \* Sonoma, CA 95476-0329 \* (707) 938-8441 \* Fax (707) 938-0764



## 2" AOD Polypropylene & PVDF Parts List

(Teflon Elastomers)

**PRICE PUMP CO.**


AOD2P-Tplist.doc rev. F

Key #	Description	Quantity	Part #	Material
1	Chamber, Pump	2	47-988-□□	Customer Preference
4	Plate, Diaphragm (Outer)	2	47-985-80	PVDF
6	Diaphragm	2	44-101-50	Teflon
7	Plate, Diaphragm (Inner)	2	48-663-00	Stainless Steel
8	Bumper	2	44-106-00	Polyurethane
9	Cap Screw	16	3085	Stainless Steel
11	Cap Screw	8	60-024-00	Stainless Steel
12 +	Seal	2	46-060-00	Molythane
14 +	Seal	2	44-372-00	Molythane
15 +	Gasket, Air Valve / Chamber	1	48-636-00	Santoprene
16	Shaft, Pump	1	46-175-00	Steel – Nitrided
23	Manifold, Discharge	1	47-986-□□	Customer Preference
24	Manifold, Suction	1	47-987-□□	Customer Preference
28	Seat, ball Valve	4	47-983-50	Teflon
29	Ball Valve	4	44-102-50	Teflon
32	Hex, Nut	16	60-061-00	Steel – Zinc Plated
35	Cap Screw, Socket Head	8	51-640-00	Stainless Steel
36	Cap, Spool, Air Valve	2	46-217-40	Aluminum
37 +	Gasket, Cap	2	46-218-00	Polyurethane
38	Pipe Plug	1	60-056-00	Stainless Steel
39 +	Spool, Air Valve	1	47-180-00	Phenolic
42	Elbow	2	44-129-00	Polypropylene
43 +	Sleeve, Bushing	2	44-120-00	Bronze
44 +	Muffler	2	44-127-66	Polypropylene
45 +	Piston Ring w/ Expander	2	44-366-00	Phenolic / Stainless Steel
47	O-ring	4	46-182-00	Teflon Encapsulated Viton
48	Backup Diaphragm	2	46-233-10	Buna
50	Diagaurd	2	45-503-00	Teflon
51	Gortex Tape	2	60-001-00	Teflon
52	Cap Screw	16	60-024-00	Stainless Steel
57	Cage, Ball Valve	4	47-991-□□	Customer Preference
68	Housing, Spool	1	47-996-10	Stainless Steel
82 +	Pilot Spool, Air Valve	1	47-587-00	Phenolic / Stainless
86	Chamber, Air	2	47-995-00	Polypropylene
91	Cap Screw	4	48-946-00	Alloy – Zinc Plated
95	Cap Screw, Socket Head	4	48-950-00	Stainless Steel
96	Flat Washer	56	49-015-00	Stainless Steel
98 +	Gasket, Spool Housing	1	48-967-00	Santoprene
99	Capscrew, Flat Socket Head	2	49-018-00	Alloy – Zinc Plated
100	Coupling Nut	1	49-017-00	Steel – Zinc Plated
Air Valve Rebuild Kit				
	-Includes All Parts with +	1	48-620-00	
	Elastomer Kit	1	49-051-55	

□□ Pump Material:    00 – Polypropylene  
                               80 – PVDF



PRICE PUMP CO.

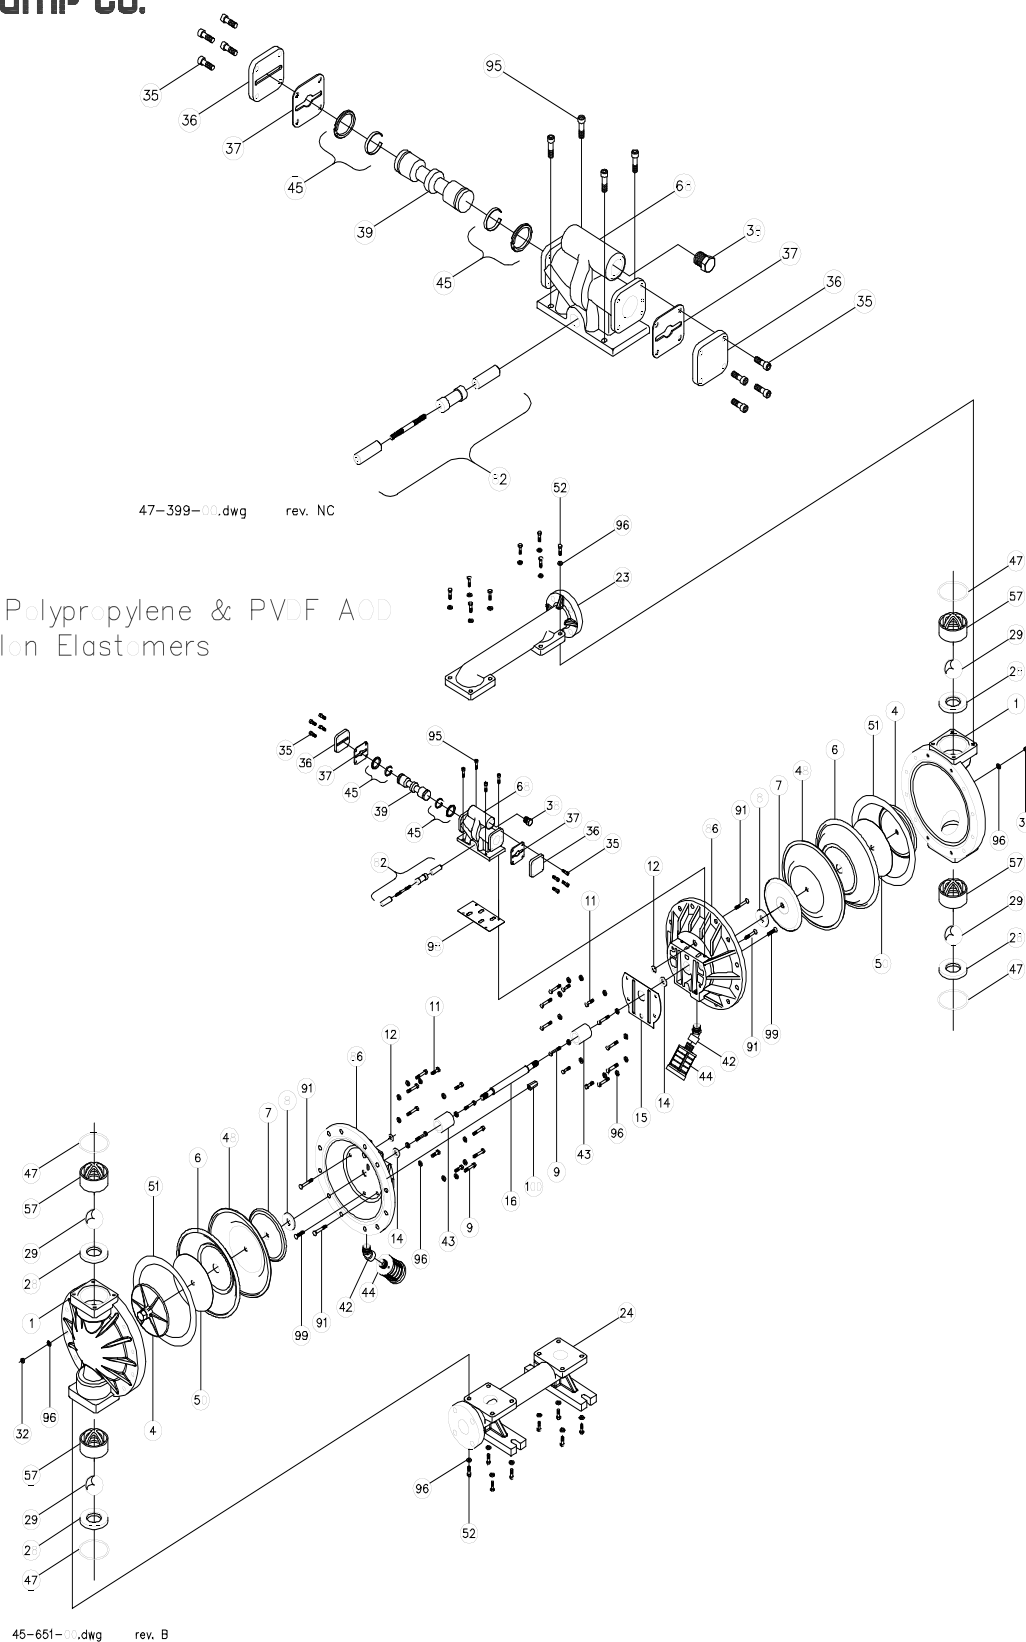

Price Pump Co.

21775 Eighth Street East \* Sonoma, CA 95476-0329 \* (707) 938-8441 \* Fax (707) 938-0764



## 2" AOD Polypropylene ATEX Compliant

(All Elastomers Except Teflon)

**PRICE PUMP CO.**


AOD2P-ATEXplst.doc rev. A

Key #	Description	Quantity	Part #	Material
1	Chamber, Pump	2	47-988-60	Polypropylene with Statkon
4	Plate, Diaphragm (Outer)	2	47-985-80	PVDF
6	Diaphragm	2	44-101-**	Customer Preference
7	Plate, Diaphragm (Inner)	2	49-021-00	Stainless Steel
8	Bumper	2	44-106-00	Polyurethane
9	Cap Screw	16	3085	Stainless Steel
10	Spacer			
	(Only on Santoprene Elastomer Pumps)	2	49-112-00	Stainless Steel
11	Cap Screw	8	60-024-00	Stainless Steel
12 +	Seal	2	46-060-00	Molythane
14 +	Seal	2	44-372-00	Molythane
15 +	Gasket, Air Valve / Chamber	1	48-636-00	Santoprene
16	Shaft, Pump	1	49-109-00	Steel – Nitrided
23	Manifold, Discharge	1	47-986-60	Polypropylene with Statkon
24	Manifold, Suction	1	47-987-60	Polypropylene with Statkon
28	Seat, ball Valve	4	47-983-50	Teflon
29	Ball Valve	4	44-102-**	Customer Preference
32	Hex, Nut	16	60-061-00	Steel – Zinc Plated
35	Cap Screw, Socket Head	8	51-640-00	Stainless Steel
36	Cap, Spool, Air Valve	2	46-217-40	Aluminum
37 +	Gasket, Cap	2	46-218-00	Polyurethane
38	Pipe Plug	1	60-056-00	Stainless Steel
39 +	Spool, Air Valve	1	47-180-00	Phenolic
42	Elbow	2	44-129-00	Polypropylene
43 +	Sleeve, Bushing	2	44-120-00	Bronze
44 +	Muffler	2	44-127-66	Polypropylene
45 +	Piston Ring w/ Expander	2	44-366-00	Phenolic / Stainless Steel
47	O-ring			
	-Pumps using Santoprene Elastomers	4	46-182-00	Teflon Encapsulated Viton
	-Pumps using other Elastomers	4	49-***-00	Customer Preference
52	Cap Screw	16	60-024-00	Stainless Steel
57	Cage, Ball Valve	4	47-991-00	Polypropylene
68	Housing, Spool	1	47-996-10	Stainless Steel
82 +	Pilot Spool, Air Valve	1	47-587-00	Phenolic / Stainless
86	Chamber, Air	2	47-995-60	Polypropylene with Statkon
91	Cap Screw	4	48-946-00	Alloy – Zinc Plated
95	Cap Screw, Socket Head	4	48-950-00	Stainless Steel
96	Flat Washer	56	49-015-00	Stainless Steel
98 +	Gasket, Spool Housing	1	48-967-00	Santoprene
99	Capscrew, Flat Socket Head	2	49-018-00	Alloy – Zinc Plated
100	Coupling Nut	1	49-017-00	Steel – Zinc Plated
102	Terminal Ring	1	60-070-00	Tin
	Air Valve Rebuild Kit			
	-Includes All Parts with +	1	48-620-00	
	Elastomer Kit	1	49-051-**	

\*\* Elastomers:      00 – Neoprene  
                              10 – Buna-N  
                              20 – Viton  
                              30 – Nordel  
                              60 – Santoprene


\*\*\* Elastomers:      022 – Buna-N  
                              023 – Viton  
                              024 – Nordel  
                              025 – Neoprene

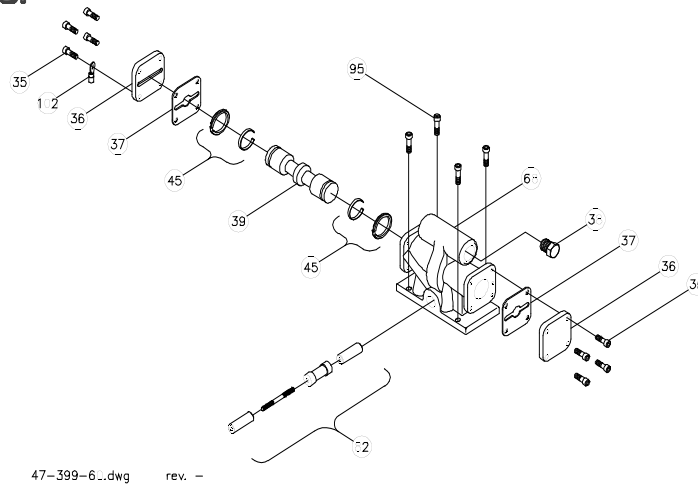

**PRICE PUMP CO.**

47-399-60.dwg rev. -

2" Polypropylene ATEX Compliant AOD  
All Elastomers (Except Teflon)

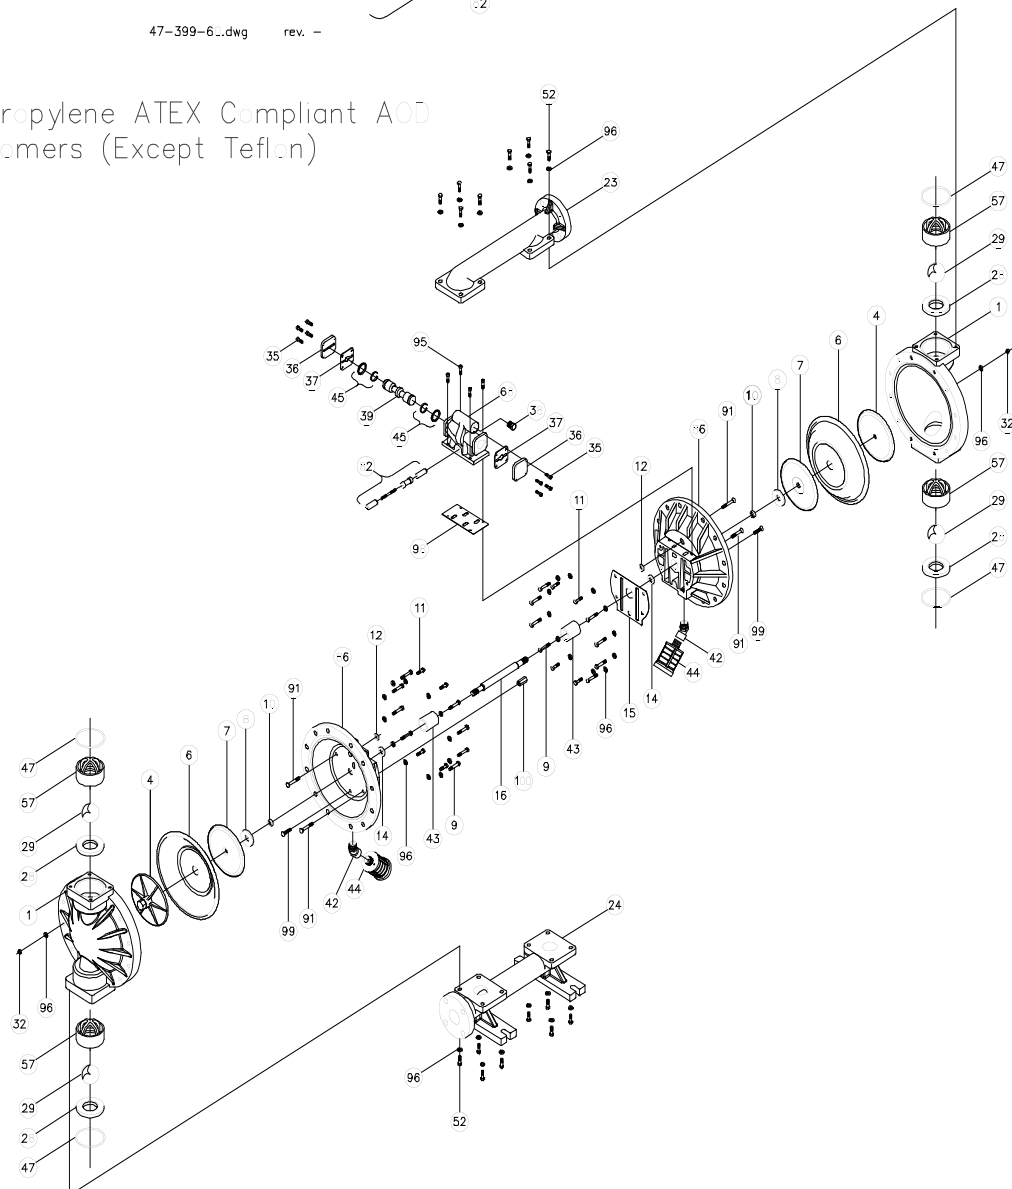

45-65-00.dwg rev. A

Price Pump Co.

21775 Eighth Street East \* Sonoma, CA 95476-0329 \* (707) 938-8441 \* Fax (707) 938-0764




## 2" AOD Polypropylene ATEX Compliant

(Teflon Elastomers)

**PRICE PUMP CO.**

AOD2P-T-ATEXplist.doc rev. B

<b>Key #</b>	<b>Description</b>	<b>Quantity</b>	<b>Part #</b>	<b>Material</b>
1	Chamber, Pump	2	47-988-60	Polypropylene with Statkon
4	Plate, Diaphragm (Outer)	2	47-985-80	PVDF
6	Diaphragm	2	44-101-50	Teflon
7	Plate, Diaphragm (Inner)	2	48-663-00	Stainless Steel
8	Bumper	2	44-106-00	Polyurethane
9	Cap Screw	16	3085	Stainless Steel
11	Cap Screw	8	60-024-00	Stainless Steel
12 +	Seal	2	46-060-00	Molythane
14 +	Seal	2	44-372-00	Molythane
15 +	Gasket, Air Valve / Chamber	1	48-636-00	Santoprene
16	Shaft, Pump	1	46-175-00	Steel – Nitrided
23	Manifold, Discharge	1	47-986-60	Polypropylene with Statkon
24	Manifold, Suction	1	47-987-60	Polypropylene with Statkon
28	Seat, ball Valve	4	47-983-50	Teflon
29	Ball Valve	4	44-102-50	Teflon
32	Hex, Nut	16	60-061-00	Steel – Zinc Plated
35	Cap Screw, Socket Head	8	51-640-00	Stainless Steel
36	Cap, Spool, Air Valve	2	46-217-40	Aluminum
37 +	Gasket, Cap	2	46-218-00	Polyurethane
38	Pipe Plug	1	60-056-00	Stainless Steel
39 +	Spool, Air Valve	1	47-180-00	Phenolic
42	Elbow	2	44-129-00	Polypropylene
43 +	Sleeve, Bushing	2	44-120-00	Bronze
44 +	Muffler	2	44-127-66	Polypropylene
45 +	Piston Ring w/ Expander	2	44-366-00	Phenolic / Stainless Steel
47	O-ring	4	46-182-00	Teflon Encapsulated Viton
48	Backup Diaphragm	2	46-233-10	Buna
50	Diagaurd	2	45-503-00	Teflon
51	Gortex Tape	2	60-001-00	Teflon
52	Cap Screw	16	60-024-00	Stainless Steel
57	Cage, Ball Valve	4	47-991-00	Polypropylene
68	Housing, Spool	1	47-996-10	Stainless Steel
82 +	Pilot Spool, Air Valve	1	47-587-00	Phenolic / Stainless
86	Chamber, Air	2	47-995-60	Polypropylene with Statkon
91	Cap Screw	4	48-946-00	Alloy – Zinc Plated
95	Cap Screw, Socket Head	4	48-950-00	Stainless Steel
96	Flat Washer	56	49-015-00	Stainless Steel
98 +	Gasket, Spool Housing	1	48-967-00	Santoprene
99	Capscrew, Flat Socket Head	2	49-018-00	Alloy – Zinc Plated
100	Coupling Nut	1	49-017-00	Steel – Zinc Plated
102	Terminal Ring	1	60-070-00	Tin
Air Valve Rebuild Kit				
	-Includes All Parts with +	1	48-620-00	
	Elastomer Kit	1	49-051-55	



## PRICE AOD® PUMP CAUTIONS & WARNINGS

- **CAUTION:** A Static charge buildup could occur in a plastic pump or an electrically insulated metal pump.
- **WARNING:** Any contaminants in the air supply will be exhausted out the muffler to the atmosphere.
- It is recommended that all piping connections to the pump should be flexible.
- **WARNING:** Verify chemical compatibility of the pump materials of construction with the fluid being pumped before use.
- Price AOD® pumps are not designed for use in sanitary or food applications.
- Submerged Price AOD® pumps should have their exhaust piped away from the liquid level. A submerged pump may leak some air from gasketed joints. Do not submerge pumps in corrosive fluids or media.
- A pump which has stopped due to air valve 'icing' will restart by itself when the ice is removed or melts.
- Use only Price Pump original equipment factory replacement parts.
- **CAUTION:** Before start-up, re-torque all external fasteners to the values listed in this I&O manual supplied with the pump.
- Pump fluid temperature limits must be observed:
  - Non-Metallic pumps - 180 - 212 deg. F max. (82 - 100 deg. C) depending on pump material or elastomers.
  - Metallic pumps - 180 - 248 deg. F max. (82 - 120 deg. C) depending on elastomers.
- **CAUTION:** Do not exceed 125 psi (8.8 Bar) air inlet pressure as component damage or personal injury may result.
- Price AOD® pumps must only be operated by clean, oil free, dry compressed air.
- Shut off, bleed down and disconnect the compressed air supply before doing any maintenance or repair to the pump.
- The pump should be flushed before disassembly. The pump should be inverted (outlet at bottom) to drain properly.
- **WARNING:** A diaphragm failure could:
  - Cause the system to which the pump is connected to be pressurized up the compressed air supply line and mix air with the fluid being pumped.
  - Cause the fluid being pumped to be sprayed out through the exhaust muffler.
- **CAUTION:** Aluminum Price AOD® pumps are not suitable for use with 1, 1, 1-trichloroethane, methylene chloride or other materials containing halogenated hydrocarbons. Aluminum wetted parts can react with these solvents and explode. Consult solvent suppliers for compatibility with aluminum pumps before installation.
- **CAUTION:** For 1-1/2", 2" and 3" Price AOD® pumps, unit weight may exceed 65 lbs. (30 kg).

Price AOD® pump sound levels at a distance of 3 ft. (1 meter) with an air inlet pressure of 35 psig.

Pump Size (in Inches)	Pump Material	Sound Pressure Level (RMS db)
1/2"	Non-Metallic	82 db
1"	Non-Metallic	82 db
1"	Metallic	82 db
1-1/2"	Metallic	82 db
2"	Non-Metallic	79 db
2"	Metallic	80 db
3"	Metallic	80 db

# Warning and Safety instructions - ATEX

Please observe all Warning and Safety notes



This symbol marks notes which contain safety relevant information. If this information is disregarded or the pump is operated not in accordance with the appropriate instructions, potentially dangerous situations may result which may cause harm to humans, production plants and machines.



This symbol marks notes and instructions relevant to installing and operating **E<sub>x</sub>** approved pumps in explosion hazardous areas.

## Pumps for use in hazardous areas

Pumps for use in explosion hazardous areas are marked accordingly showing the approved zone and group. If the pump is marked as shown below it can be used in hazardous areas, Zone 1 according to the current ATEX regulations. The special conditions for this operation must be strictly adhered to as outlined in the ATEX manual.




**II 2 G c II T4**  
**LU 03 ATEX M003X**



The pump must be connected to earth. The wire used for this must have a cross section of not less than **4 mm<sup>2</sup>**.



The wire used to earth the pump must be connected to the Air Valve of the pump (as shown in the drawing below), and then to the earth. Prior to any installation work on the pump the earthing wire has to be connected. If the pump is being removed the earthing wire must be removed last.

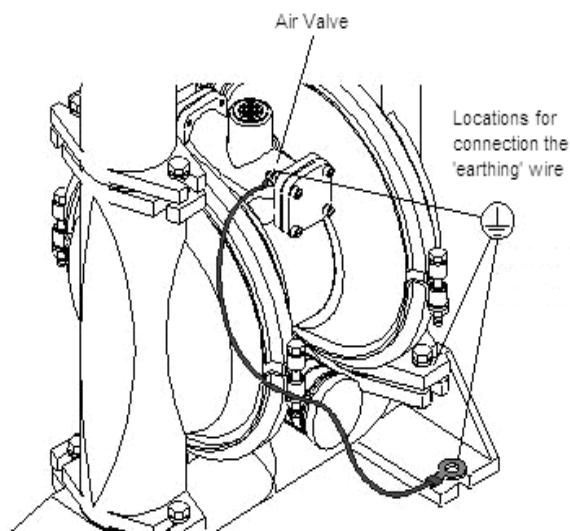

Any maintenance work on the pump should only be carried out by trained maintenance personnel.



If the pump is modified in any way, without the approval of the manufacturer, the pump may not be installed or used in hazardous areas.



PRICE PUMP



## EC Declaration of Conformity / EG Konformitätserklärung / Déclaration de conformité CE

we, wir, nous

Price Pump Company  
21775 Eight Street East  
Sonoma CA. 95476 USA

bearing sole responsibility, hereby declare that the product:  
*erklären in alleiniger Verantwortung, dass das Produkt;*  
*déclarons de notre seule responsabilité que le produit:*

**Air-operated double diaphragm Pump Series**  
*Druckluftgetriebene Doppelmembranpumpe Serie*  
*Pompe pneumatique à double membrane Série*

**AOD.5 / AOD.1 / AOD.2**  
**conductive Polypropylen**  
*leitendes Polypropylen*  
*Polypropylen conductible*

referred to by this declaration of conformity with the following standards or normative documents  
*auf das sich diese Erklärung bezieht, mit der nachfolgenden Norm oder normativen Dokumente übereinstimmt*  
*auquel se rapporte la présente déclaration est conforme aux normes ou aux documents normatifs suivants.*

EN 13463-1: 2009	<b>Non-electrical equipment for use in potentially explosive atmospheres, basic method and requirements</b> <i>Nicht-elektrische Geräte in explosionsgefährdeten Bereichen, Grundlagen</i> <i>Matériels non électriques pour utilisation en atmosphères explosibles, Prescriptions et méthodes de base</i>
EN 13463-5: 2003	<b>Non-electrical equipment for use in potentially explosive atmospheres, protection by constructional safety</b> <i>Nicht-elektrische Geräte in explosionsgefährdeten Bereichen, konstruktive Sicherheit</i> <i>Matériels non électriques pour utilisation en atmosphères explosibles, Protection par sécurité de construction</i>
EN 14121-1: 2008	<b>Safety of machinery Risk assessment</b> <i>Sicherheit von Maschinen Risikobeurteilung</i> <i>Sécurité des machines - Appréciation du risque</i>
EN 1127-1: 2007	<b>Explosive atmospheres. Explosion prevention and protection Basic concepts and methodology</b> <i>Explosionsfähige Atmosphären – Explosionsschutz Grundlagen und Methodik</i> <i>Prévention de l'explosion et protection contre l'explosion – Notions fondamentales et méthodologie</i>
98/37/EG	<b>Directive of the European Parliament and of the Council of 22<sup>nd</sup> June 1998 on the approximation of the laws of the Member States relating to machinery</b> <i>Richtlinie des Europäischen Parlaments und des Rates vom 22. Juni 1998 zur Angleichung der Rechts- und Verwaltungsvorschriften der Mitgliederstaaten für Maschinen</i> <i>Directive 98/37/CE du Parlement Européen et du Conseil du 22 juin 1998 concernant le rapprochement des législations des États membres relatives aux machines</i>
94/9/EG	<b>Directive 94/9/EC of the European Parliament and the Council of 23<sup>rd</sup> March 1994 on the approximation of the laws of the member states concerning equipment and protective systems intended for use in potentially explosive atmospheres.</b> <i>Richtlinie des Europäischen Parlaments und des Rates vom 23. März 1994 zur Angleichung der Rechtsvorschriften der Mitgliedstaaten für Geräte und Schutzsysteme zur bestimmungsgemässen Verwendung in explosionsgefährdeten Bereichen</i> <i>Directive 94/9/CE du Parlement Européen et du Conseil du 23 mars 1994 concernant le rapprochement des législations des États membres relatives aux équipements et systèmes protectives pour utilisation en atmosphères explosibles</i>

**Type of protection**  
*Zündschutzart*  
*Mode de protection Ex*

 **II 2G c T4**  
**Fördermedium T<sub>max</sub> 82° C**


**Registry number**  
*Registriernummer*  
*Numéro d'enregistrement*

**LU 09 ATEX 0068**

**Place: Sonoma, Ca**  
*Ort*  
*Lieu*

**Date: 26.05.2009**  
*Datum*  
*Date*

  
Joe Keechler  
Quality Manager  
Price Pump Co.

  
Pawel Bankowski  
Director of Engineering  
Price Pump Co.



# GENERAL TERMS OF SALE FOR PRODUCTS

## 1. GENERAL

A. Seller's price is based on these sales terms and conditions. The agreement and inclusion of other or amended terms in this contract will result in a change (including increase) in Seller's price (as may be contained in any price books or quotations) to reflect such other or amended terms. This contract shall represent the final, complete and exclusive statement of the agreement between the parties and may not be modified, supplemented, explained or waived by parole evidence, any Terms and Conditions contained in Buyer's purchase order or request for quotation, any course of dealings between the parties, Seller's performance or delivery, or in any other way. The Terms and Conditions of this contract may only be modified or waived in a written document signed by an Officer of Seller. These terms are intended to cover all activity of Seller and Buyer hereunder, including sales and use of products, parts and work and all related matters (references to products include parts and references to work include construction, installation and start-up). Any reference by Seller to Buyer's specifications and similar requirements are only to describe the products and work covered hereby and no warranties or other terms therein shall have any force of effect. Any information provided by Seller including, but not limited to, suggestions as to specific equipment does not imply any guarantee of specific suitability and/or material compatibility in a particular application, since many factors outside the control of Seller may affect the suitability of products in a particular application. Catalogs, circulars, similar pamphlets and information contained on websites of the Seller are issued for general information purposes only and shall not be deemed to modify the provisions hereof.

B. The agreement formed hereby and the language herein shall be construed and enforced under the Uniform Commercial Code as in effect in the State of California on the date hereof.

## 2. TAXES

Any sales, use or other similar type taxes imposed on this sale or on this transaction and/or any import or export duties or fees as may be assessed or imposed on or as a result of deliveries under this transaction are not included in the price. Such taxes shall be billed separately to the Buyer. Seller will accept a valid exemption certificate from the Buyer if applicable; however, if an exemption certificate previously accepted is not recognized by the governmental taxing authority involved and the Seller is required to pay the tax covered by such exemption certificate. Buyer agrees to promptly reimburse Seller for the taxes paid.

## 3. PERFORMANCE, INSPECTION AND ACCEPTANCE

A. Unless Seller specifically assumes installation, construction or start-up responsibility, all products shall be finally inspected and accepted within thirty (30) days after arrival at point of delivery. Where seller has responsibility for installation, construction or start-up all work shall be finally inspected and accepted within thirty (30) days after completion of the applicable work by Seller. All claims whatsoever by Buyer, (including claims for shortages) except only those provided for under the WARRANTY AND LIMITATION OF LIABILITY AND PATENTS Clauses, hereof, must be asserted in writing by Buyer within said thirty (30) day period or they are waived. If this contract involves partial performance, all such claims must be asserted within said thirty (30) day period for each partial performance. There shall be no revocation of acceptance. Rejection may be only for defects substantially impairing the value of products or work and Buyer's remedy for lesser defects shall be those provided for under the WARRANTY AND LIMITATION OF LIABILITY Clause.

B. Seller shall not be responsible for non-performance or for delays in performance occasioned by any causes beyond Seller's reasonable control, including, by way of example and not limitation, to labor difficulties, delays of vendors or carriers, fires, governmental actions, or shortages of material, components, labor, or manufacturing facilities. Any delays so occasioned shall affect a corresponding extension of Seller's performance dates, which are, in any event, understood to be approximate. IN NO EVENT SHALL BUYER BE ENTITLED TO INCIDENTAL OR CONSEQUENTIAL DAMAGES FOR LATE PERFORMANCE OR FOR A FAILURE TO PERFORM. Seller reserves the right to make partial shipments and to ship products, parts or work which may be completed prior to the scheduled performance date.

C. In the event that Seller has agreed to mount motors, turbines, gears, or other products which are not manufactured by Seller and which are not an integral part of Seller's manufactured product, and a delay in the delivery of such products to Seller occurs that will cause a delay in Seller's performance date, Seller reserves the right to ship its product upon completion of manufacture and to refund an equitable portion of the amount originally included in the purchase price for mounting without incurring liability for non-performance.

D. Seller reserves to itself the right to change its specifications, drawings and standards if such changes will not impair the performance of its products, and parts, and further those products, and parts, will meet any of Buyer's specifications and other specific product requirements which are a part of this agreement. Seller is a global supplier of products and utilizes parts and products obtained worldwide, and Seller's products supplied under this contract shall be subject to Seller's sole determination as to all manufacturing, sourcing, assembly and supply unless otherwise specifically agreed in writing.

E. The manufacture and inspection of products and parts shall be to Seller's Engineering and Quality Assurance standards, plus such other inspections or tests or documentation as are specifically agreed to by Seller. Requirements for any additional inspection, tests, documentation, or Buyer witness of manufacture, test, and/or inspection shall be subject to additional charges.

## 4. TITLE AND RISK OF LOSS

Title and risk of loss shall pass to buyer upon delivery of products at the designated "Ex Works" as defined by Incoterms, unless otherwise agreed by the parties.

## 5. EROSION AND CORROSION

It is specifically understood that products and parts sold hereunder are not warranted for operation with erosive or corrosive fluids or for operation with any fluid or under any operating condition in variance with the specifications of this contract. No product or part shall be deemed to be defective by reason of failure to resist erosive or corrosive action of any fluid and Buyer shall have no claim whatsoever against Seller therefore. No product shall be deemed defective by reason of any effect on Seller's products of the action or results (such as vibration) of any goods or system (such as piping) not supplied by Seller.

## 6. BUYER'S RESPONSIBILITY

The design specifications of the equipment require the operation of the equipment within certain parameters and may call for the use of speed controls, safety devices, set points or other control devices to insure that the operation remains within design parameters. Buyer agrees and understands that the equipment must be operated and maintained within design specifications and operated within the specifications of the contract, irrespective of whether controls or devices are otherwise required.

## 7. WARRANTY AND LIMITATION OF LIABILITY.

A. Seller warrants only that its product and parts, when shipped, will be free from defects in materials and workmanship. All claims for defective products or parts under this warranty must be made in writing immediately upon discovery and, in any event, within two (2) years of shipment by seller and all claims for defective work must be made in writing immediately upon discovery. Defective items must be held for Seller's inspection and returned to the sellers' point of original shipment upon request.

ANY UNAUTHORIZED DISSASSEMBLY, ALTERATION OF OR TAMPERING WITH ANY PRODUCT OR COMPONENT MAY "VOID" THE WARRANTY, IN THAT SUCH ACTION WILL RESULT IN SELLER BEING RELEASED AND RELIEVED FROM ITS OBLIGATIONS UNDER THIS WARRANTY AND FOR ANY FURTHER COSTS OR ACTIONS UNDER CLAUSE 7.C, FOLLOWING, AND THE BUYER ASSUMING SOLE RESPONSIBILITY FOR THE COSTS AND RESULTS OF SUCH ACTION. THE FOREGOING IS EXPRESSLY IN LIEU OF ALL OTHER WARRANTIES WHATSOEVER, EXPRESS, IMPLIED AND STATUTORY, INCLUDING WITHOUT LIMITATION, THE IMPLIED WARRANTIES OF MERCHANTABILITY AND FITNESS.

B. ANY PRODUCT (S) SOLD HEREUNDER WHICH ARE NOT MANUFACTURED BY SELLER ARE NOT WARRANTED BY SELLER and shall be covered only by the express warranty, if any, of the manufacturer thereof. With respect to products and parts not manufactured by Seller, Seller's only obligation shall be to assign to Buyer, to the extent possible, whatever warranty Seller obtains from the manufacturer.

C. Upon Buyer's submission of a claim as provided above and its substantiation, Seller shall at its option either (i) repair or replace its product, part or work at the original place of shipment, or (ii) refund an equitable portion of the purchase price.

D. THE FOREGOING IS SELLER'S ONLY OBLIGATION AND BUYER'S EXCLUSIVE REMEDY FOR BREACH OF WARRANTY AND, EXCEPT FOR THE REMEDIES PERMITTED UNDER THE PERFORMANCE, INSPECTION AND ACCEPTANCE AND THE PATENTS CLAUSES HEREOF, THE FOREGOING IS BUYER EXCLUSIVE REMEDY AGAINST SELLER FOR ALL CLAIMS ARISING HEREUNDER OR RELATING HERETO WHETHER SUCH CLAIMS ARE BASED ON BREACH OF CONTRACT, TORT (INCLUDING NEGLIGENCE OR STRICT LIABILITY), INDEMNITY OR OTHER THEORIES. BUYER'S FAILURE TO SUBMIT A CLAIM AS PROVIDED ABOVE SHALL SPECIFICALLY WAIVE ALL CLAIMS FOR DAMAGES OR OTHER RELIEF, INCLUDING BUT NOT LIMITED TO CLAIMS BASED ON LATENT DEFECTS. IN NO EVENT SHALL BUYER BE ENTITLED TO INDIRECT, SPECIAL, INCIDENTAL OR CONSEQUENTIAL DAMAGES, NOR FOR DAMAGES FOR LOSS OF USE, LOST PROFITS OR REVENUE, INTEREST, LOST GOODWILL, WORK OR PRODUCTION STOPPAGE, IMPAIRMENT OF OTHER GOODS, INCREASED EXPENSES OF OPERATION, OR THE COST OF PURCHASING REPLACEMENT POWER OR OTHER SERVICES BECAUSE OF SERVICE INTERRUPTIONS. FURTHERMORE, IN NO EVENT SHALL SELLER'S TOTAL LIABILITY FOR DAMAGES OF BUYER EXCEED THE PURCHASE PRICE OF THE PRODUCTS OR PARTS MANUFACTURED BY SELLER AND UPON WHICH SUCH LIABILITY IS BASED. ANY ACTION ARISING HEREUNDER RELATED HERETO, WHETHER BASED ON BREACH OF CONTRACT, TORT (INCLUDING NEGLIGENCE) OR OTHER THEORIES, MUST BE COMMENCED WITHIN ONE (1) YEAR AFTER THE CAUSE OF ACTION ACCRUES OR IT SHALL BE BARRED.

## 8. PURCHASER'S REPRESENTATIONS & WARRANTIES

Purchaser represents and warrants that the product(s) covered by this contract shall not be used in or in connection with a nuclear facility or application. The parties agree that this representation and warranty is material and is being relied on by seller. This provision may be modified in a separate writing signed by an officer of Price Pump Co.

## 9. PATENTS

Seller agrees to assume the defense of any suit for infringement of any patents brought against Buyer to the extent of such suit charges infringement of an apparatus or product claim by Seller's product in and of itself, provided (i) said product is built entirely to Seller's design, (ii) Buyer notifies Seller in writing of the filing of such suit within ten (10) days after the service of process thereof, and (iii) Seller is given complete control of the defense of such suit, including the right to defend, settle and make changes in the product for the purpose of avoiding infringement of any process or method claims. Provided however, Seller will not defend any suit for infringement of a claimed patent where such alleged infringement is the result of following specific instruction furnished by Seller.

## 10. EXTENT OF SUPPLY

Only products as listed in Seller's proposal are included in this agreement. It must not be assumed that Seller has included anything beyond same.

## 11. MANUFACTURING SOURCES

To maintain delivery schedules, Seller reserves the right to have all or any part of the Buyer's order manufactured at any of Sellers', sellers' licensees or sub contractors' plants, globally.

## 12. TERMS OF PAYMENT

Net 30 days from date of invoice.

## 13. ARBITRATION

In the event a dispute arises between the parties relating to or arising out of this agreement, the parties agree to attempt to have their senior management amicably settle the matter. In the event that the matter cannot be settled, the parties shall submit all disputes relating to this Agreement (whether contract, tort, products liability or otherwise) to binding Arbitration before a panel of arbitrators under the Commercial Dispute Resolution Procedures of the American Arbitration Association. Each party shall appoint an arbitrator and the third shall be selected in accordance with the rules of the American Arbitration Association. Judgment upon the award may be entered in any court having jurisdiction. The parties shall cooperate in providing reasonable disclosure of relevant documents. Each party shall bear its own expenses, and the costs and fees of the arbitration shall be borne as allocated by the Arbitrator.